

# LE4050M INSTALLATION MANUAL

---

29011324R001





# Contents

Introduction.....	5
Agency Listings and Approvals.....	5
Safety instructions.....	8
DSC connect technical support.....	8
Product description.....	9
Main features.....	9
Technical specifications.....	9
LE4050M package contents.....	10
Wiring the communicator to the DSC Power Series Neo alarm panels.....	11
DSC Powerseries NEO panel programming.....	11
Wiring the communicator to the DSC PowerSeries alarm panels.....	12
DSC PowerSeries panel programming.....	13
Mounting the communicator.....	14
LED indicator status.....	15
Troubleshooting.....	15
Device registration in the DSC installer portal and DSC connect installer app.....	15
Adding monitoring station reporting channel.....	15
Adding a new device.....	15
Adding a device from the DSC installer web portal.....	15
Adding a device from the DSC Connect Installer app.....	16
Limited warranty.....	16
End-user license agreement (EULA).....	20
Copyright and trademark.....	22



# Introduction

## Agency Listings and Approvals

### FCC/ISED CANADA CLASS B DIGITAL DEVICE NOTICE

This equipment has been tested and found to comply with the limits for a class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communication. However, there is guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna
- Increase the separation between the equipment and receiver
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected
- Consult the dealer or experienced radio/television technician for help

CAN/ICES-3 (B) / NMB-3 (B)

This device complies with Part 15 of the FCC rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference and (2) this device must accept any interference received, including interference that may cause undesired operation.

### FCC/ISED CANADA WIRELESS NOTICE

This equipment complies with FCC and ISED Canada radiation exposure limits set for an uncontrolled environment. The antenna should be installed and operated with minimum distance of 20 cm between radiator and your body. Cet appareil est conforme aux limites d'exposition aux rayonnements de la FCC et ISED Canada pour un environnement non contrôlé. L'antenne doit être installé de façon à garder une distance minimale de 20 centimètres entre la source de rayonnements et votre corps.

Antenna gain must be as per below. Gain de l'antenne doit être comme ci-dessous:

**Table 1: LTE antenna gain**

Frequency band / Bande de fréquence	Antenna gain / Gain de l'antenne
B1	1.315
B2	1.3525
B3	1.4
B4	1.5
B5	1.3375
B8	1.6075
B12	-0.18
B13	0.1125
B18	1.6125
B19	1.265
B20	1.695
B25	1.3525
B26	1.40875

**Table 1: LTE antenna gain**

Frequency band / Bande de fréquence	Antenna gain / Gain de l'antenne
B27	1.875
B28	0.35575
B66	1.4
B85	-0.18

**Table 2: 2G antenna gain**

Frequency band / Bande de fréquence	Antenna gain / Gain de l'antenne
850	1.69
900	1.4
1800	1.4
1900	1.5

This transmitter shall not be co-located or operating in conjunction with any other antenna or transmitter. L'émetteur ne doit pas être colocalisé ou fonctionner en conjonction avec une autre antenne ou émetteur.


## FCC/ISED CANADA LABEL

This modular transmitter is labeled with its own FCC ID and IC number. When the module is installed inside the host device (Alarm System PowerSeries, or NEO PowerSeries) and the FCC ID/ IC of the module is not visible, the host device shall display the provide label referring to the FCC ID and IC of the enclosed module. This label is shipped together with the model LE4050M and it is the responsibility of the integrator to apply it to the exterior of the enclosure as displayed in the following figure. Cet émetteur modulaire est étiqueté avec son propre ID FCC et son numéro IC. Lorsque le module est installé à l'intérieur du dispositif hôte (Alarm System PowerSeries ou NEO PowerSeries) et que FCC ID / IC du module ne siot pas visible, le dispositif d'accueil affiche l'etiquette fournie se référant à ID / FCC at IC du module ci-joint.Ce label est livré avec le module et il est de la responsabilité de l'intégrateur de l'appliquer de l'enceinte, comme indiqué dans la figure suivante.

Contains FCC ID: RI7ME310G1WW

Contains IC: 5131A-ME310G1WW

**Figure 1: Label placement**

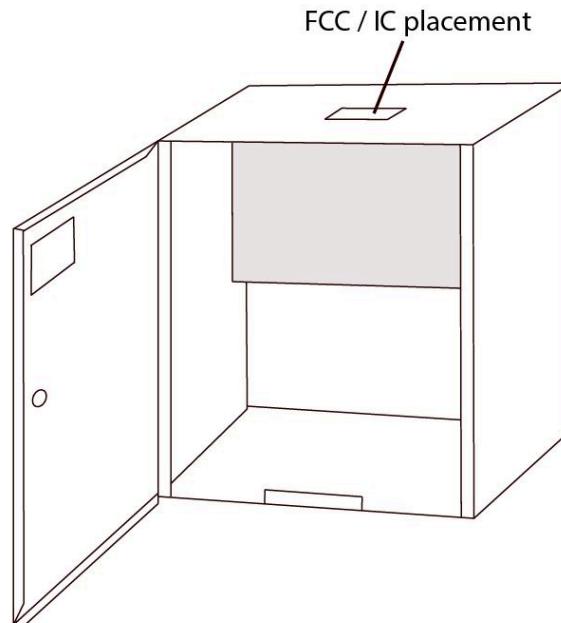

These approvals apply only to the module specified in this document.

- ETL Standards for United States
  - UL 2610:2021 Commercial Premises Security Alarm Units and Systems
  - UL 985:2015 Household Fire Warning System Units
  - UL 1023:2017 Household Burglar-Alarm System Units
- ETL Standards for Canada
  - ULC S304:2016 Control Units, Accessories and Receiving Equipment for Intrusion Alarm Systems
  - ULC S545:2002 Residential Fire Warning System Control Units

## Safety instructions

- This unit must be checked by a qualified technician once a year.
- The LE4050M device contains a radio transceiver operating in LTE CAT-M1 band.
- Do not use the Device with medical devices, or where it can interfere with other devices and cause any potential danger.
- Do not expose the Device to high humidity, chemical environment, or mechanical impacts.
- Do not use the Device in hazardous environment. Don't store or install the Device in overheated, dusty, wet, or overcooled places.
- The Device is mounted in limited access areas. Any system repairs must be done only by qualified, safety aware personnel. Don't disassemble or refit the Device. Do not attempt to personally repair it.
- Mains power must be disconnected before any installation or tuning work starts. The device installation or maintenance must not be done during stormy conditions.
- The device must be powered by DC 12-15V power supply of the alarm panel.
- Blown fuses or any other components of the Device must not be replaced by the user.
- Keep the Device dry. Any liquid, i.e. rain, moisture, may destroy or damage the inside circuitry.
- Handle carefully. Don't vibrate or shake it violently.
- Don't clean it with chemicals, detergent.
- Please read the user manual carefully before installation and operation of the Device. Otherwise, it may not work properly or be destroyed.

## DSC connect technical support

- Phone: 1 800 387-3630
- Email: [techsupport@connect24.com](mailto:techsupport@connect24.com)
- Website: <https://www.dsc.com/>



## Product description

The LE4050M is a digital serial port alarm communicator. It represents the latest communication technology for the security industry. The communicator is equipped with dual-SIM supporting multiple carriers per country.

This communication solution is a complete communication platform for data transfer from alarm systems at remote sites to Central Monitoring Stations (CMS). The platform allows bi-directional data transmission by using LTE CAT-M1 network.

## Main features

- Direct RS232 Serial Port connection – supporting event reporting from DSC PowerSeries and DSC PowerSeries NEO alarm panels.
- Exceptional Redundancy – Dual-SIM device
- High reliability due to the new LTE CAT-M1 network and redundant servers.
- Web-based software and smartphone app for devices configuration and administration
- Remote firmware updates.
- End-user smartphone app for remote alarm panel control and live push and email notifications.
- Remote panel upload / download

## Technical specifications

Criteria	Value
Brand	DSC
Model	LE4050M
Product name	Cellular Alarm Communicator
Country of origin	Bulgaria
Use	Communicates signals from protected premises alarm system to supervising station and end-user application. For use in dry, indoor, ordinary locations
Internal radio module/modem(s)	Telit ME310G1-WW CAT-M1/2G/NB-IoT Module
TAC Number (Assigned to internal radio module/modem)	35451359, 35594652 assigned to internal radio modem
Cellular Operation Frequency bands (transmission and reception)	LTE Bands: B1,B2, B4, B5, B8, B8_US, B12, B13, B18, B19, B25, B26, B27, B28, B66, B71, B85 2G Bands: B2, B3, B5, B8
Cellular Maximum EIRP	LTE: 23 dBm (Power Class 3) GSM/GPRS 33 dBm (Power Class 4)
Cellular Modulation Type	GSMK, BPSK, 8PSK, QPSK, 16QAM
Cellular Emission Designator	244KGXW, 245KGXW, 247KGXW, 249KG7W,247KG7W, 186KG7D, 129KG7D, 1M12G7D,1M12W7D, 185KG7D, 1M11G7D, 184KG7D,127KG7D, 1M10G7D, 1M10W7D, 128KG7D,130KG7D, 1M11W7D
Standard communication protocols	LTE Cat M1, LTE NB2, GPRS (2G)

Criteria	Value
SAR Certificate	N/A (device operated at > 20 cm from human body)
Operating temperature	Operating temperature: 0 °C to 49 °C (32 °F to 120 °F)
Dimensions	1,73" x 3.58" (44 x 90 mm)
Weight	0.05 kg (excluding the antenna)

## LE4050M package contents


Inside the box of the LE4050M you will find the following items:

- LE4050M Cellular Communicator
  - GSM Antenna with 1 m (3 ft) cable, SMA connector
  - 4-pin + 1-pin PC Link cables\*
  - 3 pcs. plastic standoffs for device mounting withing the alarm panel box
  - Leaflet with credentials for the DSC Connect end-user mobile app and the Config Key and Serial Number needed to register the device on the DSC Installer App/Portal.
- \*4-pin cable is used for wiring to the DSC PowerSeries  
4-pin + 1-pin cable altogether are used for wiring to the DSC PowerSeries Neo Alarm Panels.

## Wiring the communicator to the DSC Power Series Neo alarm panels

- Recommended location and wiring methods must be in accordance with the National Electrical code, ANSI/NFPA 70.
- The communicator must be powered by a control panel.
- The system should be tested once per week.
- The wiring should be done only when the panel is powered down.
- For dry/indoor use only.

**Figure 2: Wiring diagram for DSC PowerSeries Neo alarm panels**

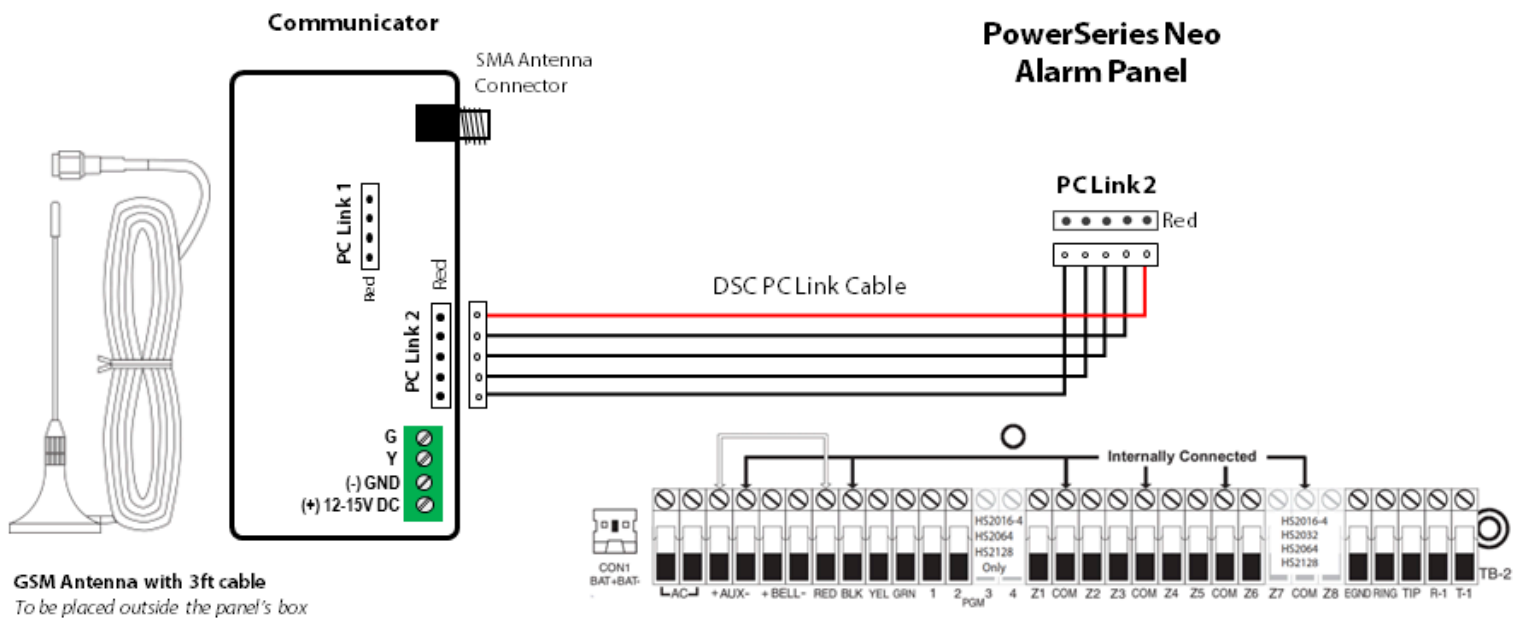

Callout	Description
PC link	Connect this terminal to PC Link 2 of the DSC PowerSeries NEO Panel, using the provided 4-pin and 1-pin PC Link Cables
PC Link 1, G, Y, (-), (+)	Not used

## DSC Powerseries NEO panel programming

Configure the following sections on the alarm panel:


- Section 382 >> enable option 5 "Alternate Comm."
- Section 300 >> set Receiver 1 to Alt. Comm Auto"
- Section 015 >> Option 7 >> Disable TLM Monitoring
- Section 310 >> Set System Account Code

## Wiring the communicator to the DSC PowerSeries alarm panels

- Recommended location and wiring methods must be in accordance with the National Electrical code, ANSI/NFPA 70.
- The communicator must be powered by a control panel.
- The system should be tested once per week.
- The wiring should be done only when the panel is powered down.
- For dry/indoor use only.

The LE4050M communicator is equipped with 2 Terminals for power supply and a 5 PIN connector that should be wired and mounted into the box of the DSC PowerSeries alarm panel.

**Figure 3: Wiring diagram for DSC PowerSeries alarm panels**

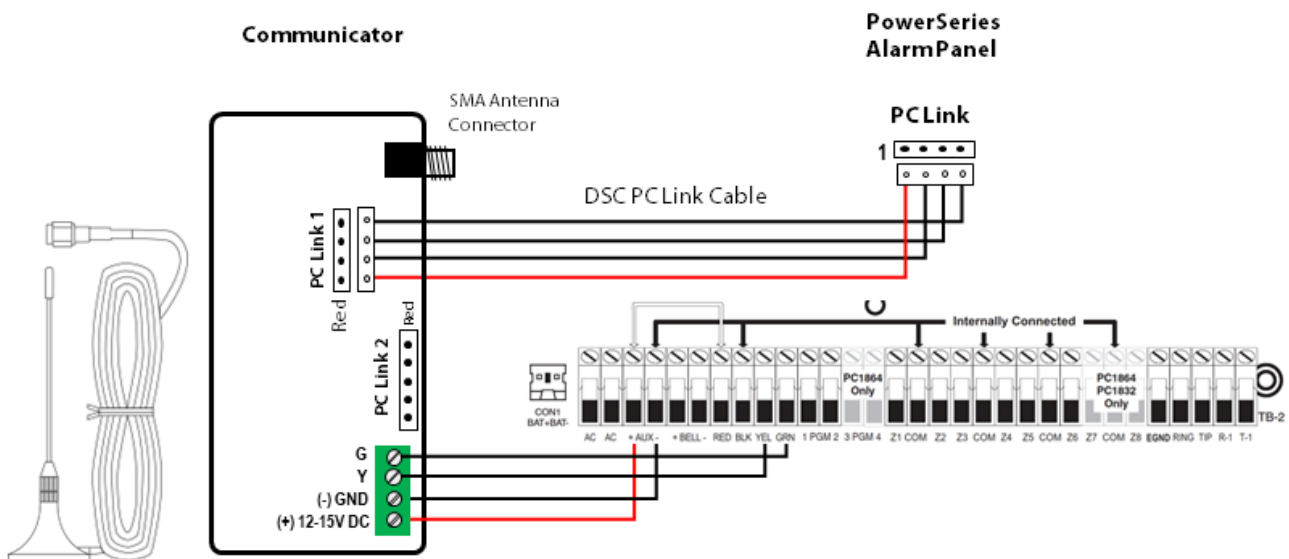

**GSM Antenna with 3ft cable**  
To be placed outside the panel's box

Callout	Description
(+)	Connect this terminal to AUX + of the DSC PowerSeries alarm panel
(-)	Connect this terminal to AUX - (GND) of the DSC PowerSeries alarm panel
G	Connect this terminal to GRN of the DSC PowerSeries alarm panel.
Y	Connect this terminal to YEL of the DSC PowerSeries alarm panel.
PC link 1	Connect this terminal to PC Link terminal of the DSC PowerSeries Panel via DSC PC Link Cable
PC link 2	Not used

## Important notes

- Use only PC link cables provided with LE4050M communicators.
- Note the “**Red**” marking on the Communicator and the “**1**” marking on the Panel
- Always connect the device to a current limited power source. Never connect it to a battery directly

## DSC PowerSeries panel programming

Configure the following sections on the alarm panel


- Section 301 >> Program HEX digits DCAA as a telephone number. Verify that the remaining digits to the end are “F”. Leading digit D is usually programmed by default and LED keyboards usually do not display it. In this case, enter only the last three digits [CAA]
- Section 350 >> Program SIA or Contact ID communication format
- Section 380 >> Ensure Communications are enabled (Toggle 1 – ON)
- Section 381 >> Ensure AUTO-SIA is disabled (Toggle 3 – OFF)
- Section 382 >> Enable the PC-Link Active option (Toggle 5 – ON)
- Section 383 >> Toggle 7 – ON, Toggle 8 – ON
- Sections 351 to 376 >> Toggle 1 – ON, Toggle 5 – ON for all relevant sections in the range. Ensure corresponding partitions are enabled.
- Section 015 >> Disable Telephone line monitoring (Toggle 7 – OFF)
- Section 406 >> Set number of rings to 001

## Mounting the communicator

This communicator comes together with 4-PIN and additional 1-PIN serial cable, external antenna, and mounting standoffs.

The device must be installed within a DSC PowerSeries/ PowerSeries NEO metal enclosure. The communicator has mounting openings matching the panel openings. The mounting is done via plastic standoffs, provided with the communicator. The antenna must be installed on top of the enclosure, removing one of the knockouts, as per the installation instructions.

**Figure 4: Mounting the communicator**

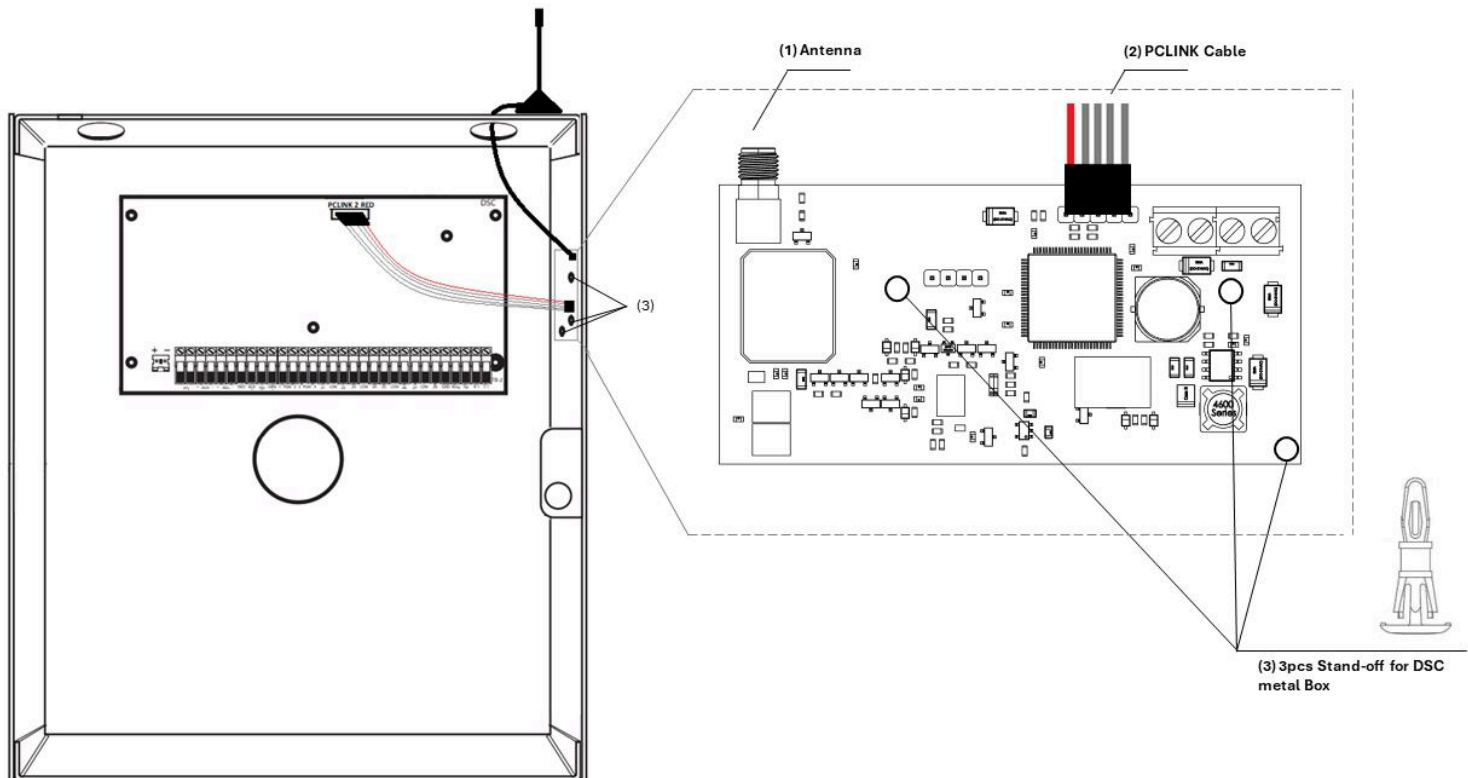

1. Mount the communicator using the provided plastic standoffs as shown in Figure 3 above.
2. Connect the antenna to the communicator. The antenna is supplied with SMA connector, that allows easy connection to the communicator. The body of the antenna has a magnet bottom and can be attached to the wall of the metal alarm panel box or use double sided adhesive type to securely attach the antenna to the box. The antenna should be positioned perpendicular to the ground, either right side up or upside down. Try to keep the antenna away from sources of RF interference or where metal objects can shield it or otherwise block the cellular radio RF signal.
3. Wire the communicator to the alarm panel – refer to the wiring sections of this manual.
4. Power up the panel.

## LED indicator status

LED status	Indication	Action
The LED is off	The unit is not connected to the panel. The power from the panel is out. The unit is damaged	Verify the wiring, refer to the wiring diagram. Measure the AUX output of the panel. Replace the unit
Slow flashing	Trying to establish connection. There is no signal available	Reposition the antenna
Constantly ON, blinking every 5 seconds	Connection established at low signal level	Reposition the antenna
Blinking – 2 seconds ON, 1 second OFF	Server to Monitoring Station connection error	
Constantly on	Connection established at good signal	
Fast blinking	Transferring data	

## Troubleshooting

If you have issues receiving the events:

1. Verify the communicator is connected to the network.
2. Verify the PC link cable is properly connected - refer to the communicator wiring sections.
3. Verify that the DSC PowerSeries/PowerSeries Neo alarm panel is properly programmed.

## Device registration in the DSC installer portal and DSC connect installer app

Register your company at <https://connect.dsc.com> or use your existing account to login the web portal

### Adding monitoring station reporting channel

Contact your monitoring station and request your Dealer Code.

Login to the DSC Installers Portal and add monitoring station reporting channels from My Devices > Monitoring Stations > Add Reporting Channel:

- Choose your preferred monitoring station from the Partner Monitoring Stations List.
- Type in the Dealer Code and Save to submit your request to the monitoring station.

### Adding a new device

Make sure you have the device Serial Number and the Config Key from the leaflet provided with the device package.

### Adding a device from the DSC installer web portal

1. Go to My Devices > Devices > Add New Device.
2. Select the preferred monitoring station/reporting channel.
3. Type in the device Serial Number and Config Key and Save.

## Adding a device from the DSC Connect Installer app

1. Go to My Devices > Devices > Add New Device.
2. Select the preferred monitoring station/reporting channel.
3. Type in the device Serial Number and Config Key and Save.

The same credentials used for the DSC Installer Portal are applicable for the DSC Connect installer App.

**Note:** The cellular service will be deactivated if the device is powered before registering it on the DSC Installers Portal or the DSC Connect App

## Limited warranty

Digital Security Controls (“DSC”), a division of Tyco Safety Products Canada Ltd, a part of the Johnson Controls group of companies (“JCI”), warrants the original purchaser that for a period of twelve months from the date of purchase, the product shall be free of defects in materials and workmanship under normal use. During the warranty period, JCI shall, at its option, repair or replace any defective product upon return of the product to its factory, at no charge for labor and materials. Any replacement or repaired parts are warranted for the remainder of the original warranty or ninety (90) days, whichever is longer. The original purchaser must promptly notify JCI in writing that there is defect in material or workmanship, such written notice to be received in all events prior to expiration of the warranty period. There is absolutely no warranty on software and all software products are sold as a user license under the terms of the software license agreement included with the product. The Customer assumes all responsibility for the proper selection, installation, operation and maintenance of any products purchased from JCI. Custom products are only warranted to the extent that they do not function upon delivery. In such cases, JCI can replace or credit at its option.

### International Warranty

The warranty for international customers is the same as for any customer within Canada and the United States, with the exception that JCI shall not be responsible for any customs fees, taxes, or VAT that may be due.

### Warranty Procedure

To obtain service under this warranty, please return the item(s) in question to the point of purchase. All authorized distributors and dealers have a warranty program. Anyone returning goods to JCI must first obtain an authorization number. JCI will not accept any shipment whatsoever for which prior authorization has not been obtained.

### Conditions to Void Warranty

This warranty applies only to defects in parts and workmanship relating to normal use. It does not cover:

- damage incurred in shipping or handling;
- damage caused by disaster such as fire, flood, wind, earthquake or lightning;
- damage due to causes beyond the control of JCI such as excessive voltage, mechanical shock or water damage;
- damage caused by unauthorized attachment, alterations, modifications or foreign objects;
- damage caused by peripherals (unless such peripherals were supplied by JCI);
- defects caused by failure to provide a suitable installation environment for the products;
- damage caused by use of the products for purposes other than those for which it was designed;
- damage from improper maintenance;
- damage arising out of any other abuse, mishandling or improper application of the products.



## Items Not Covered by Warranty

In addition to the items which void the Warranty, the following items shall not be covered by Warranty: (i) freight cost to the repair center; (ii) products which are not identified with JCI's product label and lot number or serial number; (iii) products disassembled or repaired in such a manner as to adversely affect performance or prevent adequate inspection or testing to verify any warranty claim. Access cards or tags returned for replacement under warranty will be credited or replaced at JCI's option. Products not covered by this warranty, or otherwise out of warranty due to age, misuse, or damage shall be evaluated, and a repair estimate shall be provided. No repair work will be performed until a valid purchase order is received from the Customer and a Return Merchandise Authorization number (RMA) is issued by JCI's Customer Service.

JCI's liability for failure to repair the product under this warranty after a reasonable number of attempts will be limited to a replacement of the product, as the exclusive remedy for breach of warranty. Under no circumstances shall JCI be liable for any special, incidental, or consequential damages based upon breach of warranty, breach of contract, negligence, strict liability, or any other legal theory. Such damages include, but are not limited to, loss of profits, loss of the product or any associated equipment, cost of capital, cost of substitute or replacement equipment, facilities or services, down time, purchaser's time, the claims of third parties, including customers, and injury to property. The laws of some jurisdictions limit or do not allow the disclaimer of consequential damages. If the laws of such a jurisdiction apply to any claim by or against JCI, the limitations and disclaimers contained here shall be to the greatest extent permitted by law. Some states do not allow the exclusion or limitation of incidental or consequential damages, so that the above may not apply to you.

### Disclaimer of Warranties

This warranty contains the entire warranty and shall be in lieu of any and all other warranties, whether expressed or implied (including all implied warranties of merchantability or fitness for a particular purpose) and of all other obligations or liabilities on the part of JCI. JCI neither assumes responsibility for, nor authorizes any other person purporting to act on its behalf to modify or to change this warranty, nor to assume for it any other warranty or liability concerning this product. This disclaimer of warranties and limited warranty are governed by the laws of the province of Ontario, Canada.

- ① **Note:** JCI recommends that the entire system be completely tested on a regular basis. However, despite frequent testing, and due to, but not limited to, criminal tampering or electrical disruption, it is possible for this product to fail to perform as expected.

### Out of Warranty Repairs

JCI will at its option repair or replace out-of-warranty products which are returned to its factory according to the following conditions. Anyone returning goods to JCI must first obtain an authorization number. JCI will not accept any shipment whatsoever for which prior authorization has not been obtained. Products which JCI determines to be repairable will be repaired and returned. A set fee which JCI has pre-determined and which may be revised from time to time, will be charged for each unit repaired. Products which JCI determines not to be repairable will be replaced by the nearest equivalent product available at that time. The current market price of the replacement product will be charged for each replacement unit.

### WARNING - READ CAREFULLY Note to Installers

This warning contains vital information. As the only individual in contact with system users, it is your responsibility to bring each item in this warning to the attention of the users of this system.

#### System Failures

This system has been carefully designed to be as effective as possible. There are circumstances, however, involving fire, burglary, or other types of emergencies where it may not provide protection. Any alarm system of any type may be compromised deliberately or may fail to operate as expected for a variety of reasons. Some but not all of these reasons may be:

## **Inadequate Installation**

A security system must be installed properly in order to provide adequate protection. Every installation should be evaluated by a security professional to ensure that all access points and areas are covered. Locks and latches on windows and doors must be secure and operate as intended. Windows, doors, walls, ceilings and other building materials must be of sufficient strength and construction to provide the level of protection expected. A reevaluation must be done during and after any construction activity. An evaluation by the fire and/or police department is highly recommended if this service is available.

## **Criminal Knowledge**

This system contains security features which were known to be effective at the time of manufacture. It is possible for persons with criminal intent to develop techniques which reduce the effectiveness of these features. It is important that a security system be reviewed periodically to ensure that its features remain effective and that it be updated or replaced if it is found that it does not provide the protection expected.

## **Access by Intruders**

Intruders may enter through an unprotected access point, circumvent a sensing device, evade detection by moving through an area of insufficient coverage, disconnect a warning device, or interfere with or prevent the proper operation of the system.

## **Power Failure**

Control units, intrusion detectors, smoke detectors and many other security devices require an adequate power supply for proper operation. If a device operates from batteries, it is possible for the batteries to fail. Even if the batteries have not failed, they must be charged, in good condition and installed correctly. If a device operates only by AC power, any interruption, however brief, will render that device inoperative while it does not have power. Power interruptions of any length are often accompanied by voltage fluctuations which may damage electronic equipment such as a security system. After a power interruption has occurred, immediately conduct a complete system test to ensure that the system operates as intended.

## **Failure of Replaceable Batteries**

This system's wireless transmitters have been designed to provide several years of battery life under normal conditions. The expected battery life is a function of the device environment, usage and type. Ambient conditions such as high humidity, high or low temperatures, or large temperature fluctuations may reduce the expected battery life. While each transmitting device has a low battery monitor which identifies when the batteries need to be replaced, this monitor may fail to operate as expected. Regular testing and maintenance will keep the system in good operating condition.

## **Compromise of Radio Frequency (Wireless) Devices**

Signals may not reach the receiver under all circumstances which could include metal objects placed on or near the radio path or deliberate jamming or other inadvertent radio signal interference.

## **System Users**

A user may not be able to operate a panic or emergency switch possibly due to permanent or temporary physical disability, inability to reach the device in time, or unfamiliarity with the correct operation. It is important that all system users be trained in the correct operation of the alarm system and that they know how to respond when the system indicates an alarm.

## **Smoke Detectors**

Smoke detectors that are a part of this system may not properly alert occupants of a fire for a number of reasons, some of which follow. The smoke detectors may have been improperly installed or positioned. Smoke may not be able to reach the smoke detectors, such as when the fire is in a chimney, walls or roofs, or on the other side of closed doors. Smoke detectors may not detect

smoke from fires on another level of the residence or building. Every fire is different in the amount of smoke produced and the rate of burning. Smoke detectors cannot sense all types of fires equally well. Smoke detectors may not provide timely warning of fires caused by carelessness or safety hazards such as smoking in bed, violent explosions, escaping gas, improper storage of flammable materials, overloaded electrical circuits, children playing with matches or arson. Even if the smoke detector operates as intended, there may be circumstances when there is insufficient warning to allow all occupants to escape in time to avoid injury or death.

### **Motion Detectors**

Motion detectors can only detect motion within the designated areas as shown in their respective installation instructions. They cannot discriminate between intruders and intended occupants. Motion detectors do not provide volumetric area protection. They have multiple beams of detection and motion can only be detected in unobstructed areas covered by these beams. They cannot detect motion which occurs behind walls, ceilings, floor, closed doors, glass partitions, glass doors or windows. Any type of tampering whether intentional or unintentional such as masking, painting, or spraying of any material on the lenses, mirrors, windows or any other part of the detection system will impair its proper operation. Passive infrared motion detectors operate by sensing changes in temperature. However, their effectiveness can be reduced when the ambient temperature rises near or above body temperature or if there are intentional or unintentional sources of heat in or near the detection area. Some of these heat sources could be heaters, radiators, stoves, barbeques, fireplaces, sunlight, steam vents, lighting and so on.

### **Warning Devices**

Warning devices such as sirens, bells, horns, or strobes may not warn people or waken someone sleeping if there is an intervening wall or door. If warning devices are located on a different level of the residence or premise, then it is less likely that the occupants will be alerted or awakened. Audible warning devices may be interfered with by other noise sources such as stereos, radios, televisions, air conditioners or other appliances, or passing traffic. Audible warning devices, however loud, may not be heard by a hearing-impaired person.

### **Telephone Lines**

If telephone lines are used to transmit alarms, they may be out of service or busy for certain periods of time. Also, an intruder may cut the telephone line or defeat its operation by more sophisticated means which may be difficult to detect.

### **Insufficient Time**

There may be circumstances when the system will operate as intended, yet the occupants will not be protected from the emergency due to their inability to respond to the warnings in a timely manner. If the system is monitored, the response may not occur in time to protect the occupants or their belongings.

### **Component Failure**

Although every effort has been made to make this system as reliable as possible, the system may fail to function as intended due to the failure of a component.

### **Inadequate Testing**

Most problems that would prevent an alarm system from operating as intended can be found by regular testing and maintenance. The complete system should be tested weekly and immediately after a break-in, an attempted break-in, a fire, a storm, an earthquake, an accident, or any kind of construction activity inside or outside the premises. The testing should include all sensing devices, keypads, consoles, alarm indicating devices and any other operational devices that are part of the system.

## Security and Insurance

Regardless of its capabilities, an alarm system is not a substitute for property or life insurance. An alarm system also is not a substitute for property owners, renters, or other occupants to act prudently to prevent or minimize the harmful effects of an emergency situation.

# End-user license agreement (EULA)

## IMPORTANT- READ CAREFULLY

JCI Software purchased with or without Products and Components is copyrighted and is purchased under the following license terms:

- This End-User License Agreement (“EULA”) is a legal agreement between You (the company, individual or entity who acquired the Software and any related Hardware) and Digital Security Controls, a division of Tyco Safety Products Canada Ltd., a part of Johnson Controls group of companies (“JCI”), the manufacturer of the integrated security systems and the developer of the software and any related products or components (“HARDWARE”) which You acquired.
- If the JCI software product (“SOFTWARE PRODUCT” or “SOFTWARE”) is intended to be accompanied by HARDWARE, and is NOT accompanied by new HARDWARE, You may not use, copy or install the SOFTWARE PRODUCT. The SOFTWARE PRODUCT includes computer software, and may include associated media, printed materials, and “online” or electronic documentation.
- Any software provided along with the SOFTWARE PRODUCT that is associated with a separate end- user license agreement is licensed to You under the terms of that license agreement.
- By installing, copying, downloading, storing, accessing or otherwise using the SOFTWARE PRODUCT, You agree unconditionally to be bound by the terms of this EULA, even if this EULA is deemed to be a modification of any previous arrangement or contract. If You do not agree to the terms of this EULA, JCIDSC is unwilling to license the SOFTWARE PRODUCT to You, and You have no right to use it

## SOFTWARE PRODUCT LICENSE

The SOFTWARE PRODUCT is protected by copyright laws and international copyright treaties, as well as other intellectual property laws and treaties. The SOFTWARE PRODUCT is licensed, not sold.

1. GRANT OF LICENSE This EULA grants You the following rights:

Software Installation and Use - For each license You acquire, You may have only one copy of the SOFTWARE PRODUCT installed.

Storage / Network Use - The SOFTWARE PRODUCT may not be installed, accessed, displayed, run, shared or used concurrently on or from different computers, including a workstation, terminal or other digital electronic device (“Device”). In other words, if You have several workstations, You will have to acquire a license for each workstation where the SOFTWARE will be used.

Backup Copy - You may make back-up copies of the SOFTWARE PRODUCT, but You may only have one copy per license installed at any given time. You may use the back-up copy solely for archival purposes. Except as expressly provided in this EULA, You may not otherwise make copies of the SOFTWARE PRODUCT, including the printed materials accompanying the SOFTWARE.

2. DESCRIPTION OF OTHER RIGHTS AND LIMITATIONS

Limitations on Reverse Engineering, Decompilation and Disassembly - You may not reverse engineer, decompile, or disassemble the SOFTWARE PRODUCT, except and only to the extent that such activity is expressly permitted by applicable law notwithstanding this limitation. You may not make any changes or modifications to the Software, without the written permission of an officer of JCI. You may not remove any proprietary notices, marks or labels from the Software Product.

You shall institute reasonable measures to ensure compliance with the terms and conditions of this EULA.

Separation of Components - The SOFTWARE PRODUCT is licensed as a single product. Its component parts may not be separated for use on more than one HARDWARE unit.

Single INTEGRATED PRODUCT - If You acquired this SOFTWARE with HARDWARE, then the SOFTWARE PRODUCT is licensed with the HARDWARE as a single integrated product. In this case, the SOFTWARE PRODUCT may only be used with the HARDWARE as set forth in this EULA.

Rental - You may not rent, lease or lend the SOFTWARE PRODUCT. You may not make it available to others or post it on a server or web site.

Software Product Transfer - You may transfer all of Your rights under this EULA only as part of a permanent sale or transfer of the HARDWARE, provided You retain no copies, You transfer all of the SOFTWARE PRODUCT (including all component parts, the media and printed materials, any upgrades and this EULA), and provided the recipient agrees to the terms of this EULA. If the SOFTWARE PRODUCT is an upgrade, any transfer must also include all prior versions of the SOFTWARE PRODUCT.

Termination - Without prejudice to any other rights, JCI may terminate this EULA if You fail to comply with the terms and conditions of this EULA. In such event, You must destroy all copies of the SOFTWARE PRODUCT and all of its component parts.

Trademarks- This EULA does not grant You any rights in connection with any trademarks or service marks of JCI or its suppliers.

3. COPYRIGHT - All title and intellectual property rights in and to the SOFTWARE PRODUCT (including but not limited to any images, photographs, and text incorporated into the SOFTWARE PRODUCT), the accompanying printed materials, and any copies of the SOFTWARE PRODUCT, are owned by JCI or its suppliers. You may not copy the printed materials accompanying the SOFTWARE PRODUCT. All title and intellectual property rights in and to the content which may be accessed through use of the SOFTWARE PRODUCT are the property of the respective content owner and may be protected by applicable copyright or other intellectual property laws and treaties. This EULA grants You no rights to use such content. All rights not expressly granted under this EULA are reserved by JCI and its suppliers.

4. EXPORT RESTRICTIONS - You agree that You will not export or re-export the SOFTWARE PRODUCT to any country, person, or entity subject to Canadian export restrictions.

5. CHOICE OF LAW - This Software License Agreement is governed by the laws of the Province of Ontario, Canada.

6. ARBITRATION- All disputes arising in connection with this Agreement shall be determined by final and binding arbitration in accordance with the Arbitration Act, and the parties agree to be bound by the arbitrator's decision. The place of arbitration shall be Toronto, Canada, and the installation manual of the arbitration shall be English.

#### 7. LIMITED WARRANTY

NO WARRANTY - JCI PROVIDES THE SOFTWARE "AS IS" WITHOUT WARRANTY. JCI DOES NOT WARRANT THAT THE SOFTWARE WILL MEET YOUR REQUIREMENTS OR THAT OPERATION OF THE SOFTWARE WILL BE UNINTERRUPTED OR ERROR-FREE.

CHANGES IN OPERATING ENVIRONMENT - JCI shall not be responsible for problems caused by changes in the operating characteristics of the HARDWARE, or for problems in the interaction of the SOFTWARE PRODUCT with non-JCI SOFTWARE or HARDWARE PRODUCTS.

LIMITATION OF LIABILITY - WARRANTY REFLECTS ALLOCATION OF RISK - IN ANY EVENT, IF ANY STATUTE IMPLIES WARRANTIES OR CONDITIONS NOT STATED IN THIS LICENSE AGREEMENT, JCI'S ENTIRE LIABILITY UNDER ANY PROVISION OF THIS LICENSE AGREEMENT SHALL BE LIMITED TO THE GREATER OF THE AMOUNT ACTUALLY PAID BY YOU TO LICENSE THE SOFTWARE PRODUCT AND FIVE CANADIAN DOLLARS (CAD\$5.00). BECAUSE SOME JURISDICTIONS DO NOT ALLOW THE EXCLUSION OR LIMITATION OF LIABILITY FOR CONSEQUENTIAL OR INCIDENTAL DAMAGES, THE ABOVE LIMITATION MAY NOT APPLY TO YOU.

DISCLAIMER OF WARRANTIES - THIS WARRANTY CONTAINS THE ENTIRE WARRANTY AND SHALL BEIN LIEU OF ANY AND ALL OTHER WARRANTIES, WHETHER EXPRESSED OR IMPLIED (INCLUDING ALL IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE) AND OF ALL OTHER OBLIGATIONS OR LIABILITIES ON THE PART OF JCI. JCI MAKES NO OTHER WARRANTIES.JCI NEITHER ASSUMES NOR AUTHORIZES ANY OTHER PERSON PURPORTING TO ACT ON ITS BEHALF TO MODIFY OR TO CHANGE THIS WARRANTY, NOR TO ASSUME FOR IT ANY OTHER WARRANTY OR LIABILITY CONCERNING THIS SOFTWARE PRODUCT.

EXCLUSIVE REMEDY AND LIMITATION OF WARRANTY -UNDER NO CIRCUMSTANCES SHALL JCI BE LIABLE FOR ANY SPECIAL, INCIDENTAL, CONSEQUENTIAL OR INDIRECT DAMAGES BASED UPON BREACH OF WARRANTY, BREACH OF CONTRACT, NEGLIGENCE, STRICT LIABILITY, OR ANY OTHER LEGAL THEORY. SUCH DAMAGES INCLUDE, BUT ARE NOT LIMITED TO, LOSS OF PROFITS, LOSS OF THE SOFTWARE PRODUCT OR ANY ASSOCIATED EQUIPMENT, COST OF CAPITAL, COST OF SUBSTITUTEOR REPLACEMENT EQUIPMENT, FACILITIES OR SERVICES, DOWN TIME, PURCHASERS TIME, THE CLAIMS OF THIRD PARTIES, INCLUDING CUSTOMERS, AND INJURY TO PROPERTY.

**WARNING:** JCI recommends that the entire system be completely tested on a regular basis. However,despite frequent testing, and due to, but not limited to, criminal tampering or electrical disruption, it is possible for this SOFTWARE PRODUCT to fail to perform as expected.

## Copyright and trademark

The trademarks, logos, and service marks displayed on this document are registered in the United States [or other countries]. Any misuse of the trademarks is strictly prohibited and Johnson Controls(JCI) will aggressively enforce its intellectual property rights to the fullest extent of the law, including pursuit of criminal prosecution wherever necessary. All trademarks not owned by JCI are the property of their respective owners, and are used with permission or allowed under applicable laws.

Productofferings and specifications are subject to change without notice. Actual products may vary from photos. Not all products include all features. Availability varies by region; contact your sales representative.

©2024 Johnson Controls. All rights reserved. Johnson Controls, Tyco and DSC are trademarks and/ or registered trademarks. Unauthorized use is strictly prohibited.

Techsupport: 1-800-387-3630 (Canada and U.S), or 1-905-760-3036 (International)

---